


PLAN-FRAME AND COVER

ACHESON FOUNDRY (STANDARD) A-2024-81H
ACHESON FOUNDRY (WATER-TIGHT) A-2624-71H
OR APPROVED EQUAL

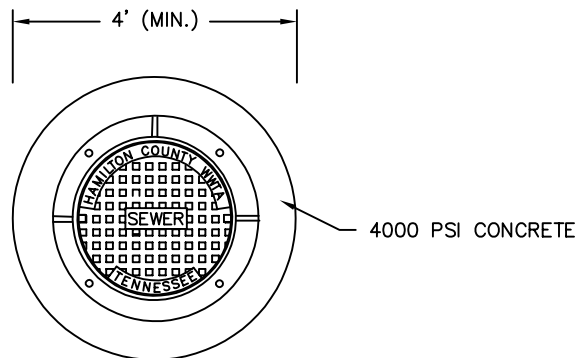

NOTES:

1. CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE THAT MORTAR AND CONSTRUCTION MATERIAL DOES NOT DROP INTO MANHOLE OR SEWER LINES
2. CONTRACTOR SHALL MAINTAIN TRAFFIC BARRIERS AND STEEL PLATES AROUND MANHOLE UNTIL CONCRETE CURES
3. THE COMBINED HEIGHT OF STACKED GRADE RINGS SHALL BE A MAXIMUM OF 12 INCHES. ADJUSTMENTS EXCEEDING A HEIGHT OF 12 INCHES REQUIRE THE USE OF A MANHOLE RISER SECTION.

STANDARD DETAIL FOR MANHOLE FINISHING AND RAISING FRAMES IN TRAFFIC AREAS

HAMILTON COUNTY WATER & WASTEWATER TREATMENT AUTHORITY
SD-MH-8